




#409922

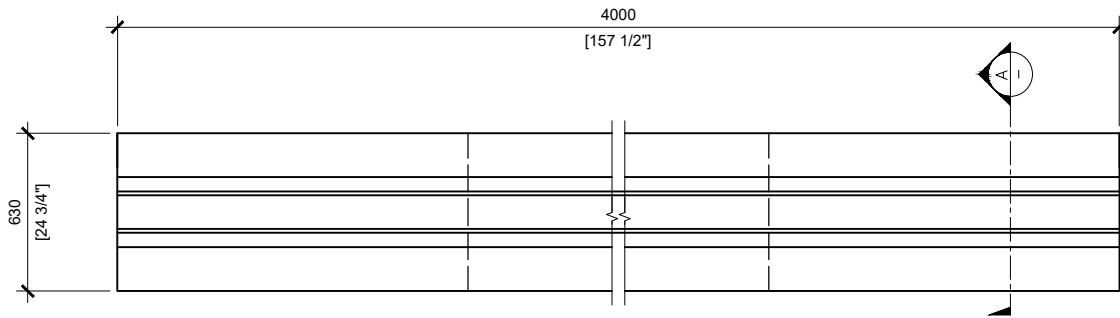


TOP VIEW  
SCALE:1/30

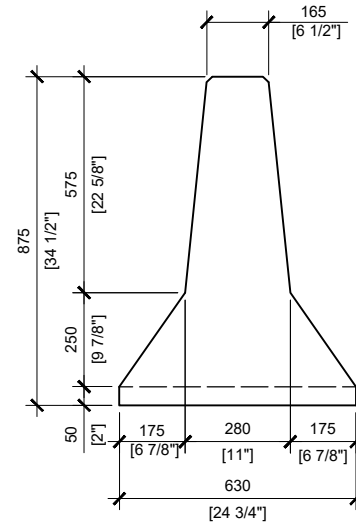

SECTION A  
SCALE:1/20

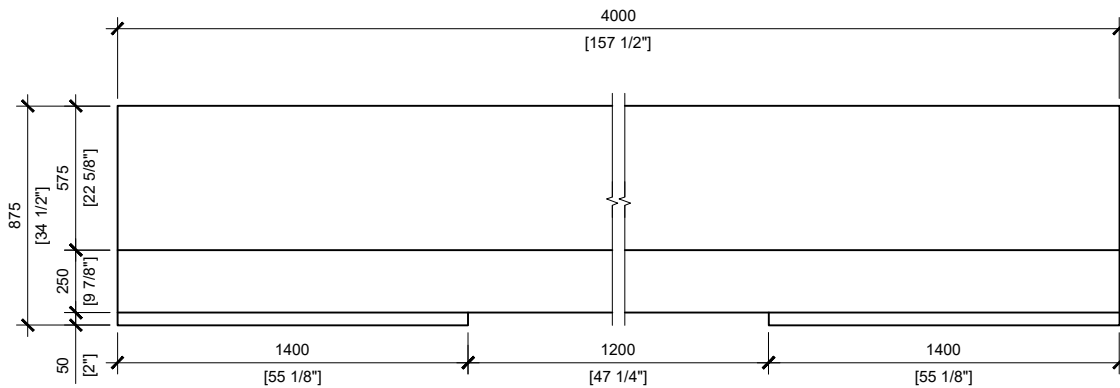

FRONT VIEW  
SCALE:1/30

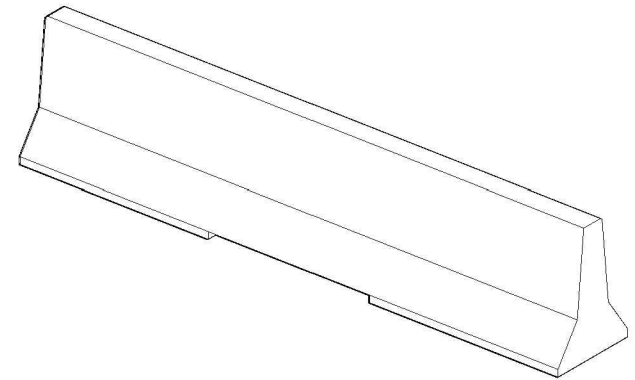

**GENERAL NOTES:**

1. ALL UNITS MUST BE HANDLE WITH PROPER LIFTING EQUIPMENT. (I.E SPREADER BAR)
2. REINFORCING AND STIRRUPS SHALL BE SIZE 10M, GRADE 400W, DEFORMED STEEL BARS. CONCRETE COVER SHALL BE 50MM MINIMUM.
3. ALL CONCRETE EDGES SHALL HAVE 15X45° CHAMFER
4. WELDS SHALL BE ACCORDING TO CSA W59 AND CSA W186.
5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.



MANUFACTURED:  
OTTAWA, ON  
613 822 1488

CONCRETE: 35MPa  
AIR ENTRAINMENT: 5-8%  
REINFORCEMENT : STEEL TO CSA CAN  
A23.1 / A23.3 / A23.4. G30.18 Fy=400MPa  
AS PER OPSD 911.140

WEIGHT:  
STANDARD I-LOCK BARRIER:  
5,060lbs / 2,300kg

DRAWN BY:  
S.RIMLAND

DATE:  
DEC/2019

**4M MEDIAN BARRIER**

CONCRETE BARRIER PRECAST 4.0m LENGTH